


BILL OF MATERIALS		
ITEM	NO.	UNIT
1	HYDRANT HEAD ASSEMBLY 90°	1 EACH
2	" " PIPE -STANDPIPE	L.F.
3	" " 90° ELBOW	1 EACH
4	" " PIPELINE	L.F.
5	" " COUPLINGS	EACH
6	" " PVC INTAKE STRAINER	1 EACH
7	NO. " STONE	C.Y.
8	"QUICK SETTING" PVC GLUE	
9	PRIMER CLEANER	
10	6"X 6"X 8' TREATED POST	2 EACH
11	4"X 4" TREATED TIMBER	1 EACH
	1/2"X 10" GALVANIZED BOLTS	4 EACH
	WITH NUTS AND WASHERS	

ALL PIPE MATERIAL SHALL BE _____ MEETING ASTM _____
 PIPELINE, STANDPIPE, & STRAINER MUST BE OF THE SAME MATERIAL

NOTE TO EXCAVATOR

UTILITY NOTIFICATION
 "The Soil Conservation District makes no representation as to the existence or non-existence of any utilities at the construction site. Shown on these construction drawings are those utilities which have been identified as the responsibility of the landowner or contractor and the contractor will assure themselves that no hazard exists or damage will occur to utilities. It is suggested that Miss Utility be contacted at: 1-800-257-7777."


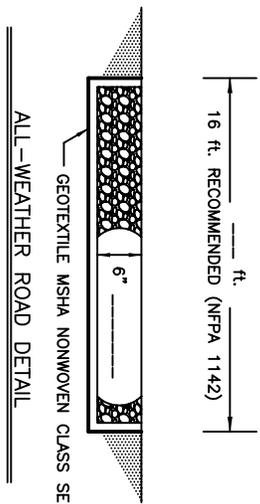


BENCHMARK DESCRIPTION:

ADDRESS:

DETAILED HYDRANT LOCATION

NO PERSON SHALL ENTER THE TRENCH UNLESS ALL PROVISIONS OF OSHA 1926 ARE MET!
 ALL EXPOSED PVC SURFACES SHALL BE PAINTED WITH REFLECTIVE MATERIAL.
 REFERENCE THE ATTACHED STANDARD "DRY HYDRANT"

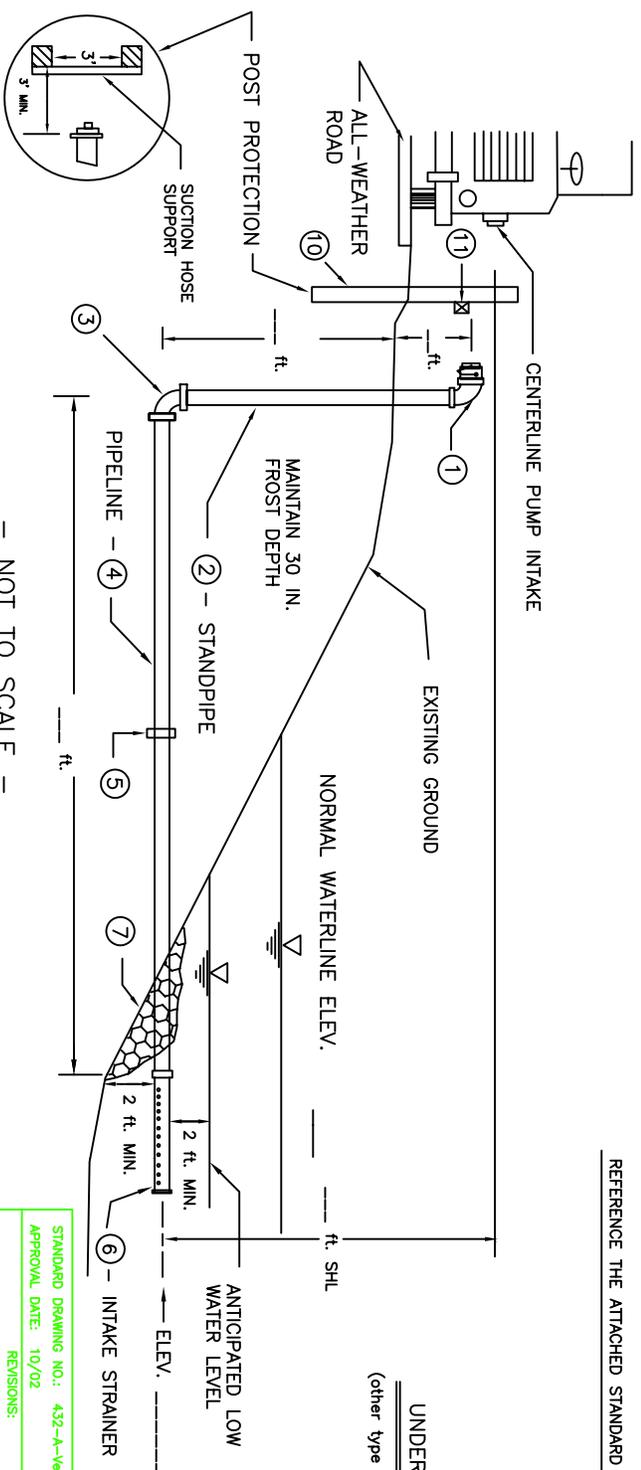

UNDERWATER SUPPORT AND ANCHOR
 (other type pipe support and anchor may be approved)

THIS INSTALLATION DESIGNED FOR _____ GPM.

DRY HYDRANT

LANDOWNER: _____
 COUNTY: _____
 U.S. DEPARTMENT OF AGRICULTURE
 NATURAL RESOURCES CONSERVATION SERVICE

STANDARD DRAWING NO.: 432-A-Vertical
 APPROVAL DATE: 10/02
 REVISIONS:

DATE: _____
 DESIGNED BY: _____
 CHECKED BY: _____
 DATE: _____
 U.S. DEPARTMENT OF AGRICULTURE
 NATURAL RESOURCES CONSERVATION SERVICE

NOT TO SCALE