
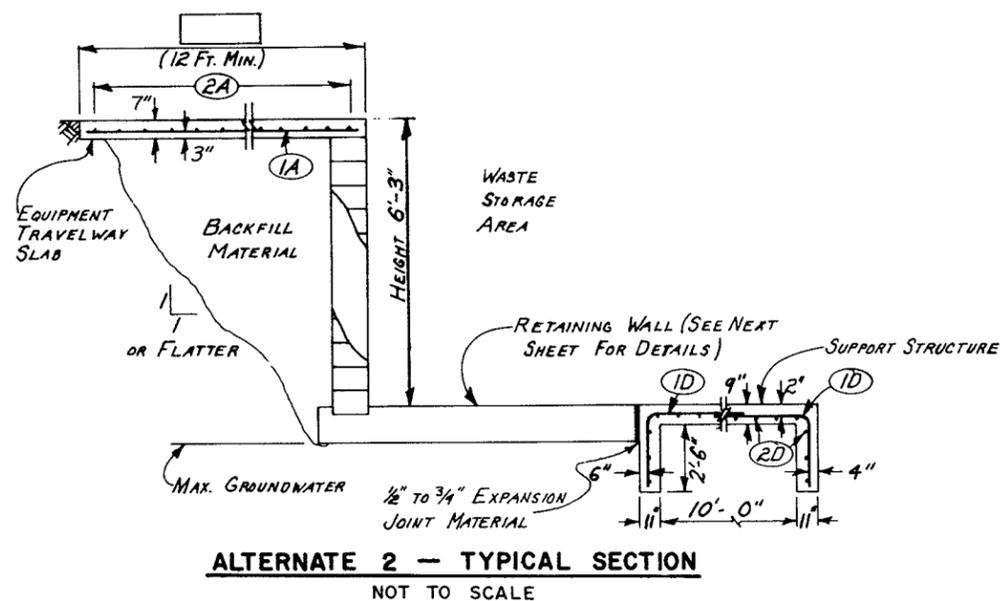
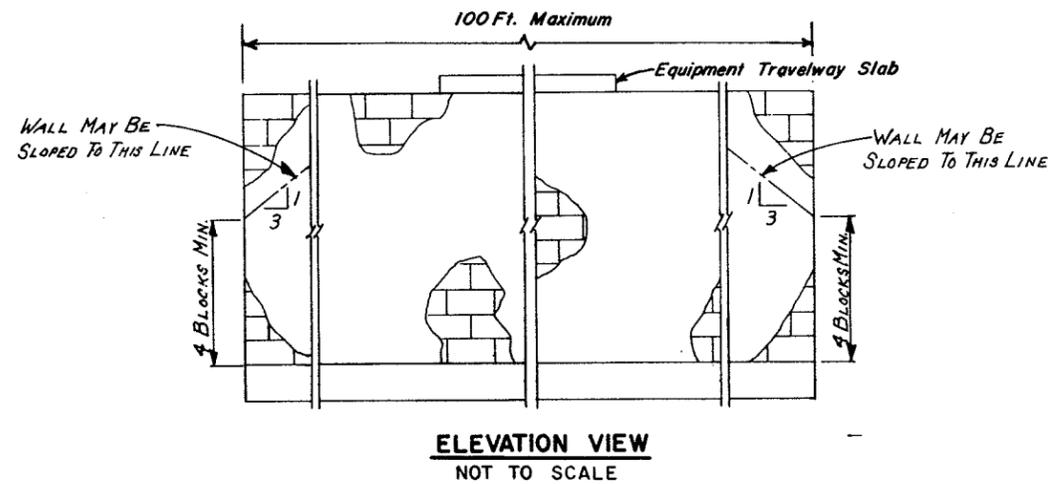


GENERAL CONSTRUCTION NOTES

1. CONSTRUCT EQUIPMENT TRAVELWAY SLAB AT ALL LOCATIONS ALONG THE WALL THAT MAY BE USED FOR EQUIPMENT TRAVEL. THE MAXIMUM ALLOWED SIZE OF EQUIPMENT IS A LOADED 1500 GALLON TANK WAGON AND/OR A 130 HP. SIZE TRACTOR.
2. CONSTRUCT A SUPPORT SLAB (ALTERNATE 1) OR SUPPORT STRUCTURE (ALTERNATE 2) EXCEPT WHERE ONE WALL FACES ANOTHER WALL.
3. CONCRETE: USE 3000 PSI MINIMUM 28 DAY COMPRESSIVE STRENGTH CONCRETE WITH A MAXIMUM AGGREGATE SIZE 1 1/2" USE A MINIMUM OF 6 BAGS OF CEMENT PER CUBIC YARD OF CONCRETE WITH A MAXIMUM OF 6 GALLONS OF WATER PER BAG OF CEMENT.
4. STEEL: USE DEFORMED REINFORCING STEEL. $f_s = 20,000$ PSI MINIMUM. (GRADE 40 OR HIGHER) LOCATE STEEL ACCURATELY IN CONCRETE, HOLD FIRMLY IN PLACE WITH WIRE TIES AND OTHER ACCESSORIES AS NEEDED.
5. CONCRETE SHALL BE EVENLY DISTRIBUTED IN THE FORMS AND VIBRATED OR TAMPED TO ASSURE MAXIMUM CONSOLIDATION. CONCRETE SHALL BE PREVENTED FROM DRYING FOR AT LEAST 7 DAYS AFTER IT IS PLACED.
6. FORMS SHALL BE MORTAR TIGHT, SUBSTANTIAL AND UNYIELDING. FORMS SHALL NOT BE REMOVED UNTIL AT LEAST 1 DAY AFTER PLACEMENT OF CONCRETE. DEFECTIVE CONCRETE (e.g. HONEY COMB) SHALL BE REPAIRED PROMPTLY AS INSTRUCTED BY SCS TECHNICIAN. CONCRETE SHALL BE PREVENTED FROM DRYING FOR AT LEAST 7 DAYS.
7. DO NOT POUR CONCRETE UNTIL SCS TECHNICIAN HAS INSPECTED FORMS AND STEEL PLACEMENT.
8. DO NOT BACKFILL THE WALLS UNTIL 10 DAYS AFTER THE WALLS HAVE BEEN CONSTRUCTED.
9. BACKFILL WITH FREE-DRAINING, NON-COHESSIVE, GRANULAR MATERIALS SUCH AS GRAVEL, SAND, OR LOAMY SAND. (UNIFIED CLASSIFICATION: GP, GW, GM, GC, SP, SW, SC, OR SM-SC)
10. PROVIDE SURFACE DRAINAGE AWAY FROM THE FACILITY.
11. FOR WALLS WITH A REQUIRED LENGTH OF MORE THAN 100 FEET, DIVIDE THE LENGTH INTO SECTIONS NOT EXCEEDING 100 FEET IN LENGTH AND PLACE EXPANSION JOINT MATERIAL BETWEEN SECTIONS.
12. THE LENGTH OF REINFORCING BAR SPLICES SHALL EQUAL AT LEAST 30 DIAMETERS OF THE SMALLER BAR BEING SPLICED, BUT NOT LESS THAN 12 IN.
13. DIMENSIONS FROM FACE OF CONCRETE TO REINFORCING BARS DESIGNATE THE CLEAR DISTANCE. (MINIMUM CLEAR DISTANCE 2")

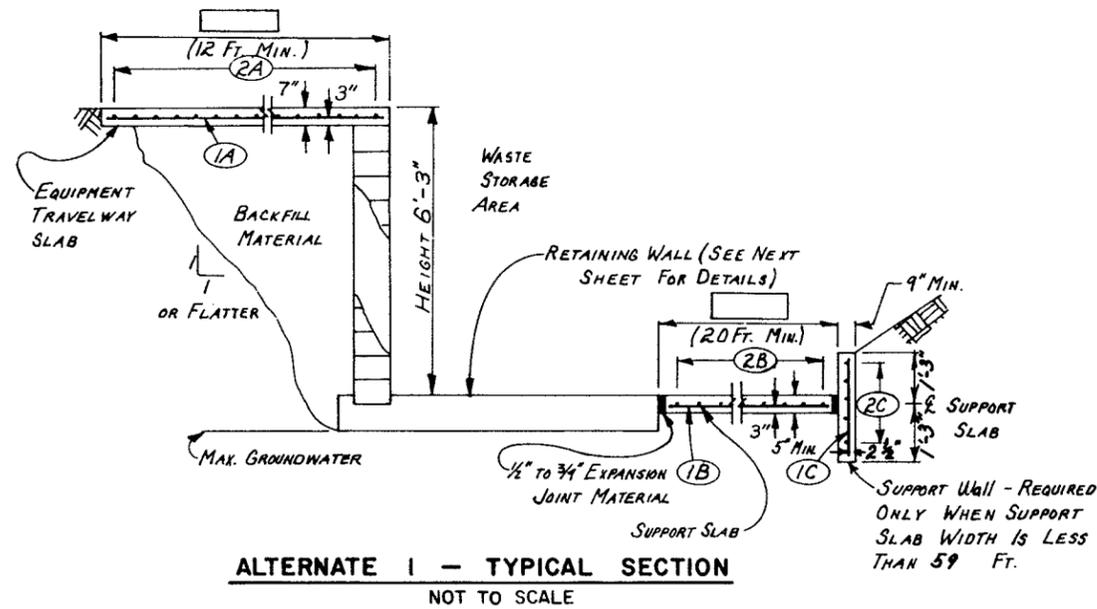


CONCRETE BLOCK CONSTRUCTION NOTES

1. MORTAR MIX (BY VOLUME): 1 PART PORTLAND CEMENT, 1 PART MASONRY CEMENT, 4-6 PARTS SAND IN DAMP, LOOSE CONDITION
2. MORTAR SHOULD BE USED WITHIN 2 HOURS AFTER ORIGINAL MIXING AND SHOULD NOT STAND MORE THAN ONE HOUR WITHOUT REMIXING.
3. GROUT MIX (BY VOLUME) FOR FILLING BLOCK CORES: 1 PART PORTLAND CEMENT, 1/4 PART MASONRY CEMENT (OPTIONAL), 2 1/2 PARTS FINE AGGREGATE, 1 1/2 PARTS COURSE AGGREGATE.
4. MAXIMUM SIZE COURSE AGGREGATE 1/2"
5. MATERIALS USED IN CONSTRUCTION SHOULD BE OF GOOD QUALITY. NO SECOND-HAND MATERIALS SHALL BE USED.
6. GROUT FILL EACH CONCRETE BLOCK CORE.
7. CONCRETE BLOCK $f_m = 1500$ PSI MINIMUM. (ASTM C-90, GRADE N, TYPE I)
8. FIRST COURSE OF BLOCKS ARE TO BE LAID IN 3" OF CONCRETE HEEL (FOOTING).
 - A. LAY MAXIMUM OF 4 COURSES OF BLOCKS PRIOR TO FILLING CORES.
 - B. EACH FILLING OF THE CORES SHALL END 4" BELOW THE TOP OF THE TOP COURSE OF BLOCKS SO AS TO FORM A CONSTRUCTION JOINT.
 - C. PLACE LAP STEEL IN FRESHLY POURED CONCRETE AND TAMP FIRMLY AROUND STEEL.
9. THE MORTAR BED SHALL BE PLACED ON ALL WEBS AS WELL AS THE SHELL. (i.e. FULL MORTAR BEDDING IS REQUIRED)

BAR TYPES

STRAIGHT
TYPE 1



BAR SCHEDULE






MARK	SIZE	QUANTITY	LENGTH	TOTAL LENGTH	TYPE	B	C	LOCATION
1A	#4@12"				1			EQUIP. SLAB
2A	#4@12"				1			EQUIP. SLAB
1B	#3@18"				1			SUPPORT SLAB
2B	#3@18"				1			SUPPORT SLAB
1C	#4@12"		2'-0"		1			SUPPORT WALL
2C	#5@12"				1			SUPPORT WALL
1D	#4@12"		9'-3"		2	2'-10"	6'-5"	SUPPORT STR.
2D	#4@12"				1			SUPPORT STR.

NOTE: Welded Wire Fabric, 6X6-6/6, may be substituted for Bar Marks 1B and 2B

**WALL HEIGHT 6 FOOT
REINFORCED CONCRETE
BLOCK RETAINING WALL
FOR ANIMAL WASTE STORAGE**

**U. S. DEPARTMENT OF AGRICULTURE
SOIL CONSERVATION SERVICE**

Designed	Date	Approved by
Drawn		Title
Traced		Title
Checked		Sheet No.
		Drawing No.
		No.
		of

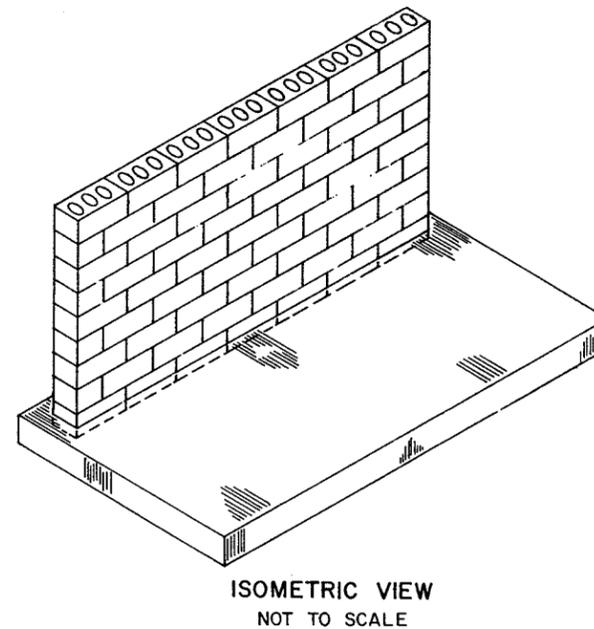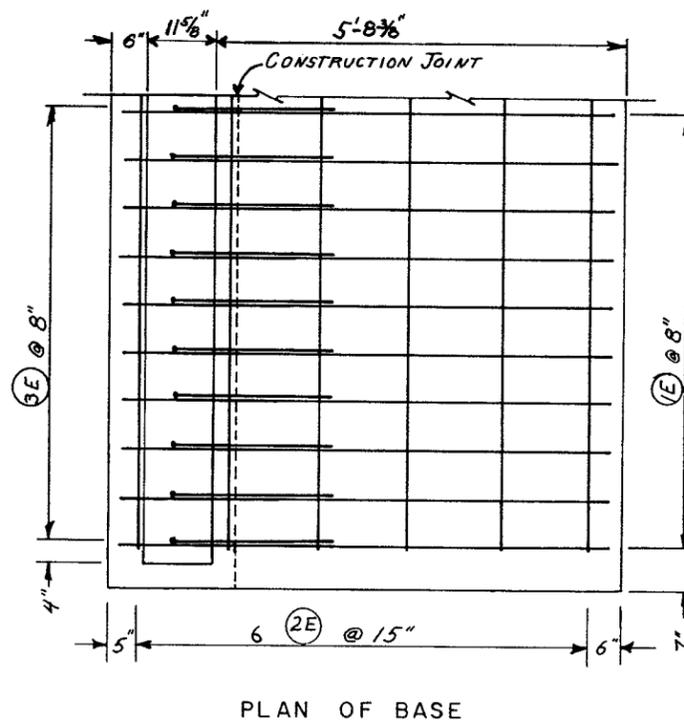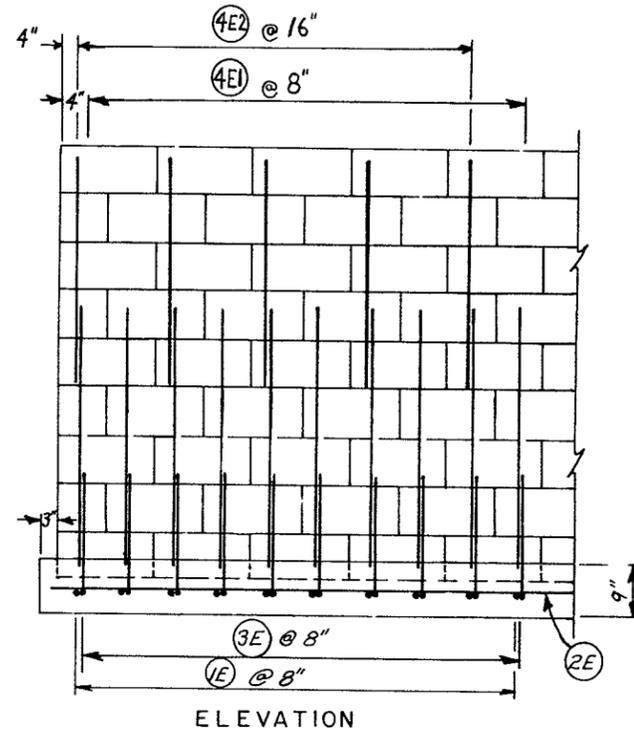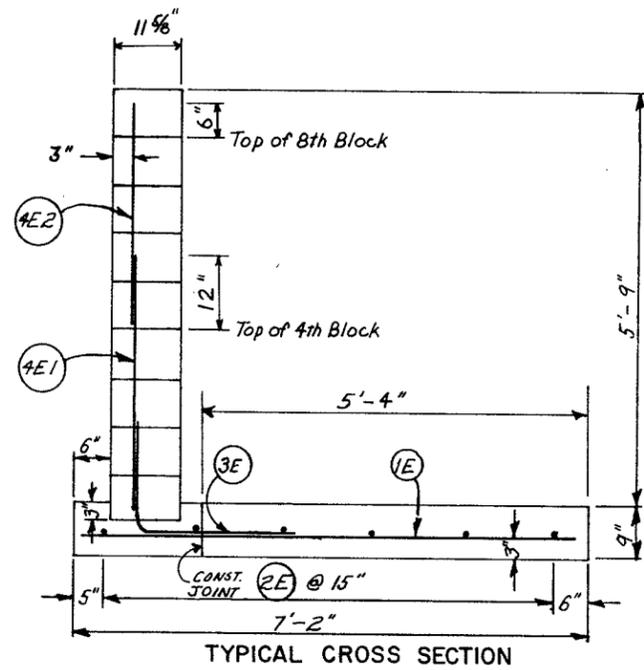


BAR TYPES

STRAIGHT TYPE 1 TYPE 21



BAR SCHEDULE							
MARK	SIZE	QUANTITY	LENGTH	TOTAL LENGTH	TYPE	B	C
1E	4		6'-9"		1	-	-
2E	5				1	-	-
3E	4		3'-9"		21	1'-6"	2'-3"
4E1	4		3'-6"		1	-	-
4E2	3		3'-2"		1	-	-

- NOTES:
- BEND RADIUS 3 BAR DIAMETERS
4 - 1 1/2 INCHES
 - MINIMUM LAP SPLICE 30 BAR DIAMETERS
3 - 12 INCHES
4 - 15 INCHES
5 - 19 INCHES
 - 0.363 CU. FT. OF MORTAR/FOOT OF WALL
0.073 CU. YDS. OF CONCRETE GROUT/FOOT OF WALL
0.200 CU. YDS. OF CONCRETE/FOOT OF BASE

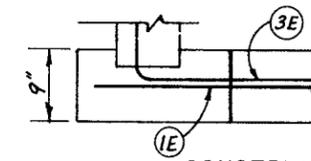

CONSTRUCTION JOINT NOTE
1E BARS DO NOT HAVE TO CONTINUE THROUGH THE CONSTRUCTION JOINT.
1E BARS MAY BE CUT AT JOINT.

CONSTRUCTION JOINT DETAIL
NOT TO SCALE

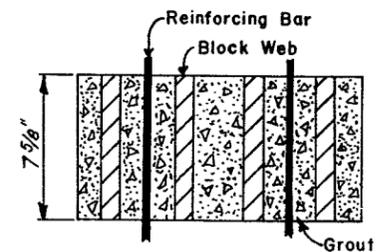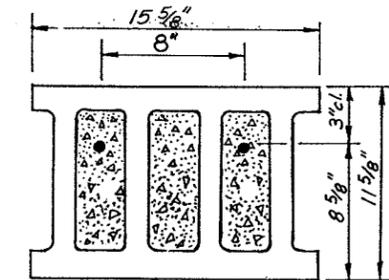

PLAN VIEW

SECTION

STANDARD BLOCK DETAIL
NOT TO SCALE

6 FT. REINFORCED CONCRETE
BLOCK RETAINING WALL FOR
ANIMAL WASTE STORAGE

U. S. DEPARTMENT OF AGRICULTURE
SOIL CONSERVATION SERVICE

MICHIGAN ENGINEERING STANDARD DRAWING	
APPROVED BY <i>Steven S. Dadd</i> S.C.E.	DATE 11-17-75
DRAWING NO. 50-E-0140	SHEET 2 OF 2

Designed	Approved by
Drawn	Title
Traced	Sheet No.
Checked	Drawing No.